

Sudler 2012 CTSU Drug Fridge
for
Sudler 2012 CTSU Drug Fridge

May 01, 2024 - Jun 01, 2024

Author: Miranda Wright
mwright15@kumc.edu

Review & approval records location:

Summary Report "Sudler 2012 CTSU Drug Fridge" for Sudler 2012 CTSU Drug Fridge

May 01, 2024 - Jun 01, 2024


MACHINE DETAILS

Serial Number: **A434F1FF2A93**
Location: **SUDLER 2012 CTSU OUTSIDE LAB**
Description: **A434F1FF2A93**
Installation date:

EQUIPMENT DETAILS

Category: **+4 Refrigerator**
Manufacturer:
Model:
Service Entered Date:

TEMPERATURE AVG: **1.51 °C** | MIN: **0.84 °C** | MAX: **5.62 °C**

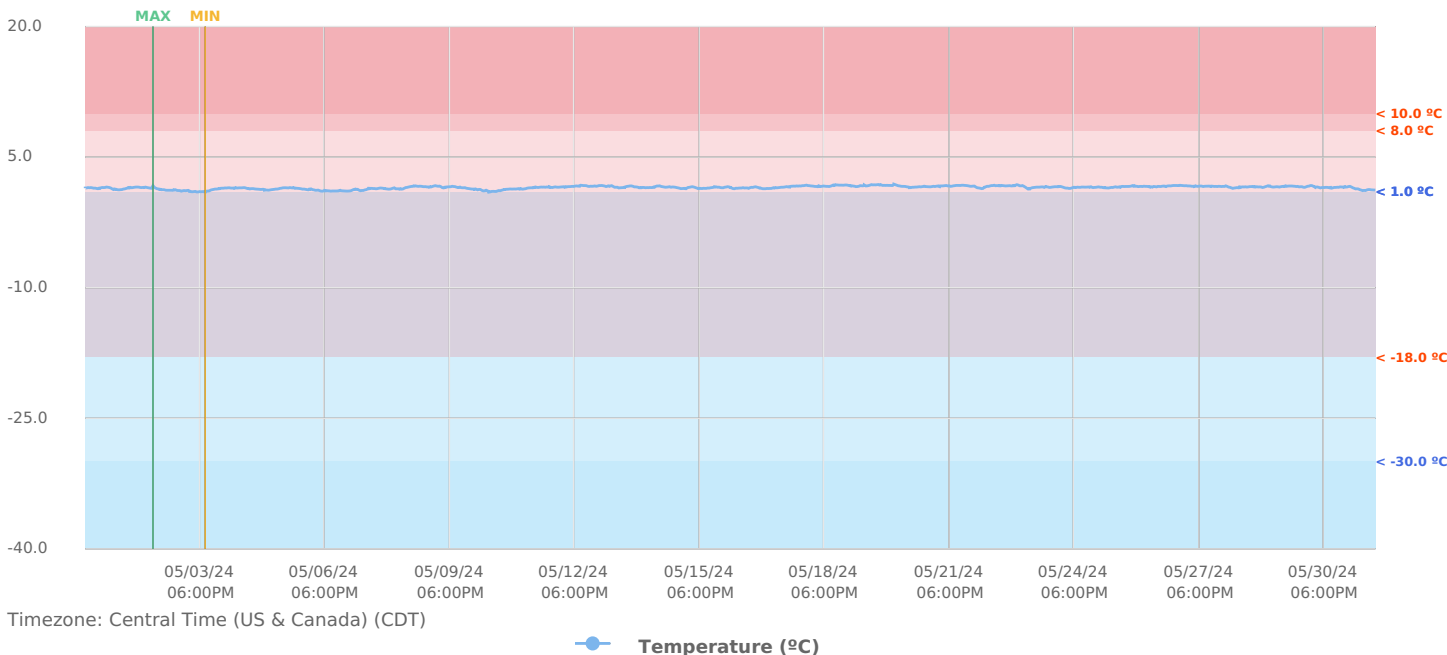

DATA LOGS

CENTRAL TIME (US & CANADA)	TEMPERATURE (°C)
2024-05-01 12:00 AM	1.48°C
2024-05-02 12:00 AM	1.38°C
2024-05-03 12:00 AM	1.23°C
2024-05-04 12:00 AM	1.09°C
2024-05-05 12:00 AM	1.38°C
2024-05-06 12:00 AM	1.51°C
2024-05-07 12:00 AM	1.1°C
2024-05-08 12:00 AM	1.3°C
2024-05-09 12:00 AM	1.57°C
2024-05-10 12:00 AM	1.49°C
2024-05-11 12:00 AM	1.16°C
2024-05-12 12:00 AM	1.47°C
2024-05-13 12:00 AM	1.71°C
2024-05-14 12:00 AM	1.51°C
2024-05-15 12:00 AM	1.53°C
2024-05-16 12:00 AM	1.43°C
2024-05-17 12:00 AM	1.45°C
2024-05-18 12:00 AM	1.61°C
2024-05-19 12:00 AM	1.82°C
2024-05-20 12:00 AM	1.71°C
2024-05-21 12:00 AM	1.52°C
2024-05-22 12:00 AM	1.76°C
2024-05-23 12:00 AM	1.56°C
2024-05-24 12:00 AM	1.57°C
2024-05-25 12:00 AM	1.51°C
2024-05-26 12:00 AM	1.71°C
2024-05-27 12:00 AM	1.59°C
2024-05-28 12:00 AM	1.66°C
2024-05-29 12:00 AM	1.66°C
2024-05-30 12:00 AM	1.73°C
2024-05-31 12:00 AM	1.42°C

THRESHOLD ALERTS

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
2024-05-10 9:21 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.05 °C	8.0/1.0 °C	Alert Cleared
						<p>Notification:Email, SMS, and App sent to Miranda Wright.</p> <p>Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.05 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.</p> <p>Alert Rule:Delp G040 +4</p>
						<p>Message:Temperature Clear: 1.05 °C, within the limit of 1.0 °C to 8.0 °C</p> <p>Alert Rule:Delp G040 +4</p>
						<p>Notification:Email, SMS, and App sent to Miranda Wright.</p> <p>Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.98 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.</p> <p>Alert Rule:Delp G040 +4</p>
						<p>Message:Temperature Alert: 0.98 °C, below the limit of 1.0 °C</p> <p>Alert Rule:Delp G040 +4</p>
2024-05-10 6:43 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.04 °C	8.0/1.0 °C	Alert Cleared

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-10 6:43 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.04 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.
						Alert Rule:Delp G040 +4
	2024-05-10 6:43 PM					Message:Temperature Clear: 1.04 °C, within the limit of 1.0 °C to 8.0 °C
						Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-10 5:54 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.98 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.
						Alert Rule:Delp G040 +4
	2024-05-10 5:54 PM					Message:Temperature Alert: 0.98 °C, below the limit of 1.0 °C
						Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-10 5:33 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.95 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.
						Alert Rule:Delp G040 +4
	2024-05-10 5:33 PM					Message:Temperature Alert: 0.95 °C, below the limit of 1.0 °C
						Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-10 5:12 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.88 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB.
						Alert Rule:Delp G040 +4
	2024-05-10 5:12 PM					Message:Temperature Alert: 0.88 °C, below the limit of 1.0 °C
						Alert Rule:Delp G040 +4
2024-05-03 9:50 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.05 °C	8.0/1.0 °C	Alert Cleared

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.05 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Clear: 1.05 °C, within the limit of 1.0 °C to 8.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.00 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 1.00 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.98 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 0.98 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.00 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 1.00 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4

2024-05-03 7:04 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.03 °C	8.0/1.0 °C	Alert Cleared
--------------------	------------------------------	-------------	---------------------	---------	------------	---------------

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 7:04 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.03 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 7:04 PM					Message:Temperature Clear: 1.03 °C, within the limit of 1.0 °C to 8.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 6:44 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.99 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 6:44 PM					Message:Temperature Alert: 0.99 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
2024-05-03 6:07 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.03 °C	8.0/1.0 °C	Alert Cleared

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.03 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Clear: 1.03 °C, within the limit of 1.0 °C to 8.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.99 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 0.99 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.00 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 1.00 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright. Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.94 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
						Message:Temperature Alert: 0.94 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4

2024-05-03 3:08 PM Sudler 2012 CTSU Drug Fridge Temperature **Delp G040 +4** 1.1 °C 8.0/1.0 °C Alert Cleared

CENTRAL TIME (US & CANADA)	MACHINE NAME	TYPE	RULE	LAST READING	LIMITS (H/L)	ACTIVITY
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 3:08 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.10 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 3:08 PM					Message:Temperature Clear: 1.10 °C, within the limit of 1.0 °C to 8.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 3:00 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.94 °C, still below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 3:00 PM					Message:Temperature Alert: 0.94 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 2:39 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.97 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 2:39 PM					Message:Temperature Alert: 0.97 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4
2024-05-03 2:19 PM	Sudler 2012 CTSU Drug Fridge	Temperature	Delp G040 +4	1.04 °C	8.0/1.0 °C	Alert Cleared
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 2:19 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 1.04 °C, within the limit of 1.0 °C to 8.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 2:19 PM					Message:Temperature Clear: 1.04 °C, within the limit of 1.0 °C to 8.0 °C Alert Rule:Delp G040 +4
						Notification:Email, SMS, and App sent to Miranda Wright.
	2024-05-03 2:02 PM					Message:Sudler 2012 CTSU Drug Fridge is reporting Temperature of 0.99 °C, below the limit of 1.0 °C. Sudler 2012 CTSU Drug Fridge is located in SUDLER 2012 CTSU OUTSIDE LAB. Alert Rule:Delp G040 +4
	2024-05-03 2:02 PM					Message:Temperature Alert: 0.99 °C, below the limit of 1.0 °C Alert Rule:Delp G040 +4

CONNECTION ALERTS

No Alert Events for selected date range.

POWER ALERTS

No Alert Events for selected date range.

ERROR ALERTS

No Alert Events for selected date range.